

# Hybrid energy systems for rural communities in Zimbabwe

Henerica Tazvinga<sup>1</sup> and Oliver Dzobo<sup>2</sup>  
{ htazvinga@csir.co.za<sup>1</sup>, oliverd@uj.ac.za<sup>2</sup> }

Council for Scientific and Industrial Research, Energy Centre, P.O. Box 395, Pretoria 0001, South Africa<sup>1</sup>, University of Johannesburg, Department of Electr. & Electronic Eng. Science, South Africa<sup>2</sup>

**Abstract.** Renewable energy sources such as solar photovoltaic (PV) systems have been widely utilized as alternative energy sources to fossil fuels in residential areas in many countries. The PV cell output varies according to many factors including weather conditions, time of day, season and location. Therefore, such systems cannot meet demand at all times necessitating incorporation of backup systems to smoothen the output and to meet electricity demand. This paper presents the modeling and operational strategy of a hybrid system consisting of a PV, diesel generator and battery. If the PV output is not enough to meet the load the generator and/or battery system compensates the power imbalance. The behavior of the proposed hybrid system is verified by simulation using HOMER Software. The simulation results indicate that hybrid systems would be feasible options for distributed generation of electric power for remote locations or areas not connected to the electricity grid..

**Keywords:** Hybrid system, distributed generation, low-carbon, environmental degradation

## 1 Introduction

It is estimated that about forty percent of the world's population depends on wood, charcoal or animal waste to satisfy basic energy needs such as cooking and heating [1]. Most of this population is in developing countries especially in rural areas where the communities are poor and marginalized. In Zimbabwe, just like in most developing countries, energy access is still a big challenge considering that its electrification rate is below forty percent. There have been many initiatives to address the energy access issue by the government and by donor agencies but the gap is still big. Zimbabwe has also joined the global effort to eliminate energy poverty by 2030 under the United Nation's Sustainable Energy for All initiative [1]. The country's energy supply is mostly from hydroelectric power and also from a few thermal coal power stations. Zimbabwe has experienced power shortages in recent years and some urban households have responded by installing PV and solar water heating systems as well as diesel and petrol generators. These renewable energy (RE) options are also important demand side management interventions to reduce the energy bills for consumers in urban areas. Innovative solar technology applications such as in street lighting and traffic lights controls have been demonstrated in a number of its urban areas.

About 80-90 % of the rural population relies on wood fuel and kerosene for cooking and lighting [1], [2]. A high proportion of the rural population is made up of peasant farmers who mostly grow maize. Grain milling is thus an important processing activity in most of these communities and is mostly carried out by diesel-powered mills. RE technologies can play an

important role in activities such as water pumping, grain milling, cell phone charging, hair salons, battery charging and lighting thereby extending study times for learners in Zimbabwe's rural communities. Establishment of small businesses that use RE based energy within the communities can help to improve the livelihoods of the rural people. Access to clean and affordable energy is therefore an urgent issue as this directly benefits people's health and well-being as documented in various literatures. Although energy access does not necessarily guarantee gender equality which is also a big challenge globally, it is a great step towards the emancipation of women by enabling them to have more time to engage in productive activities. An example of solar technology application in rural communities in Zimbabwe is the solar powered borehole water supply for Masasa Clinic, Primary and Secondary Schools donated by the Chandiwana Memorial Foundation with support from Frinton Free Church, United Kingdom and Masasa Community in Chivhu. This has benefited the community in many ways including improving access to clean water and reduction of water-borne diseases.

Many rural areas of developing countries including Zimbabwe lack supply of electricity due to poor distribution of grid electricity and/or lack of financial resources for grid extension [3]. There is also relatively low energy demand in most rural areas making it uneconomic to connect them to the grid owing to the high cost of long-range transmission lines and this justifies the use of more decentralized forms of power supply systems. These decentralized systems are modular in nature and can be built anywhere near the locations of use [4], [5]. It is also important to have reliable power supply systems that are able to provide uninterrupted power at all times. The distributed generation options for providing energy in these areas include stand-alone renewables with or without storage, diesel generator sets or a combination of these forms of energy in a hybrid system. Because of the intermittent in nature PV generation, battery banks are usually incorporated to improve the supply reliability but sometimes the storage systems have to be over-sized to achieve the required hours or days of autonomy leading to high capital costs owing to the need replace the storage batteries more times than any other component of the system. The current decrease in PV technology prices has resulted in more uptake of this technology in the residential and utility sectors. Battery bank costs are also expected go down in the near future and this is expected to result in widespread usage of batteries in rural communities. Diesel generators on the other hand, have been favoured options for off-grid applications for many years owing to their low initial capital costs. Their main disadvantages are the high operation and maintenance costs as well as their negative environmental impact.

Fuel Cell (FC)–electrolyzer combination could be considered for backup and long-term storage system with a battery bank for short-time backup to supply transient power as proposed in [6]. However, for the system to be environment friendly, the RE sources have to be sized to meet the electrolyzer's energy requirements for hydrogen production. Compared to internal combustion engines FCs operate in a silent and clean mode and also require a smaller supply of fuel, as they are more efficient. Although stationary FCs technology is near commercialization and is expected to tap into a large market in residential, commercial and industrial applications in future, currently the FC–electrolyzer system is more expensive than the diesel generator system. Another challenge associated with this technology is that the production of hydrogen (through electrolysis) using renewable electricity and the conversion back into electricity is associated with energy losses and additional costs. A combination of PV, diesel generator and battery in a hybrid system overcomes single source problems; provides environment friendly, reliable and more economic system owing to the reduced diesel generator run time, number of start/stop cycles and running costs. Use of bio diesel and

biogas generators would result in increased generation of cleaner energy especially at institutions like schools and rural clinics.

Hybrid energy system models have been presented by various authors in literature using various software and methodologies. A hybrid system consisting of PV, wind generator and battery storage for Yavatmal district in Maharashtra, India is presented in [7] and is optimized using the HOMER software. A techno-economic analysis for powering a residential building in Iran and optimized using HOMER software is presented in [8]. There is, however no single solution to satisfy community energy requirements as each location has its own site-specific energy needs, profile and characteristics. This means that appropriate technology choices should be guided by resource availability in each location; energy needs of the community, distance from current and future planned transmission grid. It is also important to consider the cost of the current and proposed energy services for the proposed users to make informed choices.

Provision of sustainable energy service for all especially the poor communities is therefore crucial in the transition from subsistence livelihoods to increased productivity, income generation, and improved living standards. Developing economies, as already pointed out above, face energy challenges in meeting the needs of billions of people who still lack access to basic, modern energy services and at the same time there is need to participate in the global transition to clean, low-carbon energy systems [9]. There is therefore a need to provide access to reliable and affordable energy services as a pre-requisite to alleviating extreme poverty and meeting other societal development goals. This paper presents a possible hybrid energy system option(s) to meet the rural energy needs in a sustainable way; and hence address energy poverty levels and improve the livelihoods of the rural population. HOMER software is used for the simulation and optimization of the system. Various energy supply implementation models are presented to enable individuals and other service providers to make informed decisions. A systems dynamics approach is used to enhance understanding of the behavior of complex systems over time (dynamics). This paper is structured as follows: introduction, hybrid energy systems, hybrid system case study, methodology, results and discussion and conclusion.

## **2 Renewable Energy Hybrid Systems**

### **2.1 System benefits**

Provision of renewable and affordable energy is crucial for the reduction of extreme poverty and for the attainment of the United Nations Sustainable Development Goal 7 which calls for access to affordable, reliable, sustainable and modern energy for all. Figure. 1 shows an example of environmental, economic and social benefits of RE systems [9]. The benefits can be explained using a causal relation between any two events and this exists in cases where the occurrence of the first causes the other. The first event is the cause and the second event is the effect. A positive causal link means the two events change in the same direction meaning that if the start link decreases, the end link also decreases and vice versa. A negative causal link means the two events change in opposite directions meaning that if the start link increases, the end link decreases and vice versa. A reduction in greenhouse gas emissions leads to a reduction in air pollution related health problems that are caused by the pollutants



Model 1- Cash Sales: the RE supplier sells the RE system directly or through a dealer to the end-user who immediately becomes the owner of the system.

Model 2- Credit sales: the end-user acquires the RE system on credit. The credit sales are divided into three categories:

- Dealer Credit: the RE supplier/dealer sells the RE system to the end-user, who also enters into a credit arrangement with the RE supplier/dealer. Depending on the arrangements, the end-user immediately becomes the owner of the system, or when all payments are made.
- End-user Credit: the RE supplier/dealer sells the RE system to the end-user, who obtains consumer credit from a third party credit institution. The end-user usually becomes the owner of the system immediately, but this can be delayed until all payments are made.
- Lease/Hire purchase: the RE supplier/dealer or a financial intermediary leases the RE system to the end-user. At the end of the lease period, ownership may or may not be transferred to the end-user, depending on the arrangements. During the lease period, the lessor remains owner of the system and is responsible for its maintenance and repair.

Model 3: Fee for service: an electricity supply company (ESCO) owns the system, and provides an energy service to the end-user, who pays a periodic fee (e.g., monthly) to the ESCO. The end-user is not responsible for the maintenance of the RE system and never becomes the owner, although the end-user may own for example the battery and lamps/radio or gas stove.

Another concept linked to hybrid systems is the mini- grids concept and mini-grids can be made of single or multiple generation sources. The business models for mini-grids may include but are not limited to the following categories [11]:

- Community-based model: the community owns and operates the mini-grid, with a cooperative often established to own and manage the system. This model usually relies on initial capital support from governments or philanthropic organizations, as well as technical support for project implementation;
- Private sector-based model: a private organization manages the construction and operation of the mini-grid, with varying levels of external financial support depending on the level of government involvement and type of subsidies available;
- Utility-based model: the national utility is responsible for the construction and operation of the mini-grid;
- Hybrid model: Involves various combinations, such as public-private partnerships where the government finances the construction of a mini-grid that is then managed by a private organization, or a privately owned mini-grid that is maintained by the community that it serves.

### **3 Hybrid system case study**

The considered system configuration is as shown in Figure. 2 below. The hybrid energy system is made up of a PV generator, diesel generator and battery storage. The dispatch strategy is such that the PV generator supplies the load whenever there is PV output, otherwise the battery storage comes in to meet the imbalance between the PV output and the load

provided it is within its operating limits. If both PV and battery cannot meet the load, the diesel generator comes in to ensure that the load is fully satisfied and also to charge the battery. The PV generator should also charge the battery whenever there is excess power. The idea is to minimize use of the diesel generator due to its high operating cost in terms of both fuel and maintenance costs.

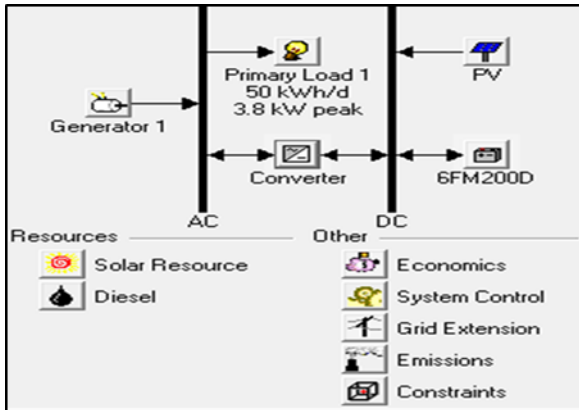


Fig. 2. Hybrid energy system configuration.

#### 4 Methodology

The HOMER Hybrid Optimization Modeling Software developed by National Renewable Energy Laboratory, USA is used for the design, optimization and analyses of hybrid power systems. These hybrid systems may contain two or more of the following: conventional generators, cogeneration, wind turbines, solar PV, hydropower, batteries, fuel cells, hydropower, biomass and other inputs. The software can analyze either grid tied or standalone systems as well as perform greenhouse gas calculations for the measures being considered [12]. HOMER allows the user to input hourly power consumption profiles and match RE generation to the required load. Additionally, HOMER contains a powerful optimizing function that is useful in determining the cost of various energy project scenarios which allows for minimization of cost and optimization of scenarios based on various factors (e.g., CO<sub>2</sub> minimization). The working principle is as shown in Figure 3.



Fig. 3. Conceptual relationship between simulation, optimization, and sensitivity analysis.

The software simulates a viable system for all possible combinations of the components considered. The simulated systems are optimized according to the user defined criteria so that the best possible solution is obtained. In addition to the economic optimization model, the user choose to minimize fuel usage by defining the relevant parameters. A sensitivity analysis is then done to observe the impact of variables, such as fuel costs, wind speed, etc., on the optimal system.

### 3.1 Load profile

Figure. 4 shows the average daily load profile for the rural based institution considered in this paper. The daily load profile is based on a survey conducted in rural communities in Zimbabwe [2].

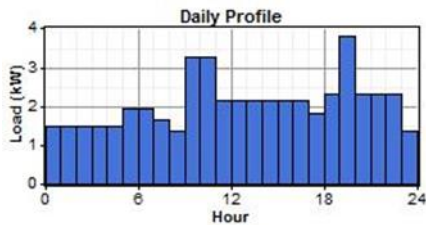


Fig. 4. Load profile [2].

An appliance usage matrix was developed for the convenient computation of the load data. It shows the time of the day and the appliance in use for each hour. This represents a 24\* number of appliance (NA) matrix which when multiplied by the NA \*1 matrix give a 1\*24 matrix that represents the load as shown in Table 1. In Table 2 the data characteristics are shown.

Table 1. Appliance Usage Matrix.

Time	Appliance in Use								
	1	2	3	4	5	6	7	8	9
1:00	1	1	0	0	0	0	1	0	0
2:00	1	1	0	0	0	0	1	0	0
3:00	1	1	0	0	0	0	1	0	0
4:00	1	1	0	0	0	0	1	0	0
5:00	1	1	0	0	0	0	1	0	1

Table 2. Data characteristics.

	Baseline	Scaled
Average (kWh/d)	50.0	50.0
Average (kW)	2.08	2.08
Peak (kW)	3.81	3.81

### 3.1 Solar resource

The solar resource data used for a selected location in Masvingo rural area was taken from NASA Surface Meteorology and Solar Energy website [12]. The annual average solar radiation for the location is 5.427 kWh/m<sup>2</sup>/day and the average clearness index is 0.542. Figure. 5 below shows the annual radiation and clearness Index for the selected site.

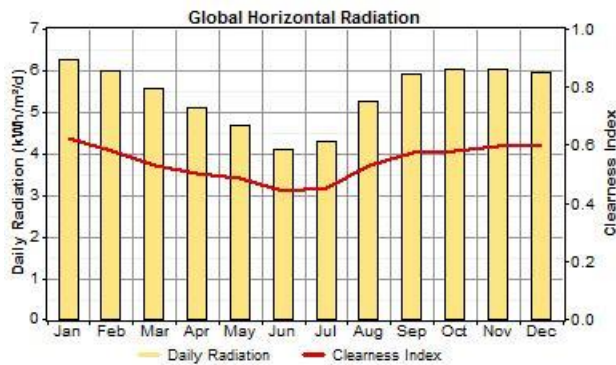


Fig. 5. Average daily radiation and Clearness Index

### 3.3 Model components

For solar PV, the following module sizes are considered: 100W, 250W and 300W solar panels from Enersol. The solar PV capacities considered in the model are 0, 0.5, 1, 1.5, 2, 2.5, 3, 3.5, 4, 4.5 and 5 kW. The cost of the solar PV panels was pegged at \$1.50/W in Zimbabwe. The rated power of the inverter is usually determined using the peak load. However, since in this case the load will be met by both solar PV panels and diesel generator, the inverter does not need to be equal or above the peak load. The cost of a 1.5kW converter is set at \$900. The replacement cost is 80% of the capital cost and the efficiency of the converter is set at 90%. Its lifetime is set at 15 years. Converter sizes considered in this research paper are 0, 1, 1.5, 2, 3, 4.5 and 6 kW.

The diesel generator is not allowed to run at less than the minimum load ratio of 30%. The maximum power rating of the diesel generator is 5.5 kW. The cost of the diesel generator is \$1500 and its lifetime is about 15000 hours. Diesel generator capacities considered in the study are 0, 2.5, 4, 5.5 kW. The price of diesel in Zimbabwe is around \$1.20/Litre. The storage battery considered in this paper is the Vision 6FM200D from Vision Battery. The nominal capacity of the battery is 200Ah (2.4kWh) with a nominal voltage of 12V for a single battery. The battery efficiency is set at 80% with a minimum state of charge of 40%. The cost of one battery is \$400 in Zimbabwe and the quantities of batteries considered are 0, 1, 2 and 3.

## 4 Results and discussion


The optimized results are shown in Table 3 and the combination with the lowest cost of energy (COE) is shown to be the best option. The strategy chosen by the software is the load following one. The cash flow summary and net present cost of each component are also shown. Table 4 shows the annualized costs of the system and also that the load is met 100% most the times. The PV array's annual energy production is 7925 kWh/yr while that for the diesel generator is 11784 kWh/yr giving a total of 19710 kWh/yr. Figure. 6 shows monthly average electric production from the PV and diesel generators. It shows how much of the total generation was contributed by each source.

**Table 3.** Optimized results

PV (kW)	Gen. (kW)	Batt	Conv (kW)	Disp. Strat.	Initial Capital (\$)	Oper. Cost (\$/yr)	Total NPC (\$)	COE (\$/kWh)	Ren Frac	Cap. short	Diesel (L)	Oper. Hours
5	2.5	1	3	LF	11538	6764	98001	0.428	0.34	0.02	4967	7161
5	2.5		3	CC	11138	6830	98444	0.434	0.32	0.03	5137	7553
	2.5	1	1	CC	2238	9773	127172	0.553	0	0.01	7277	8760
	4			CC	1500	10896	140785	0.603	0	0	8278	8760

**Table 4.** Annualized Costs

Component	Capital (\$/yr.)	Replacement (\$/yr.)	O&M (\$/yr.)	Fuel (\$/yr.)	Total (\$/yr.)
PV	587	0	75	0	662
Generator	73	418	64	5961	6515
Vision 6FM200D	31	162	4	0	198
Converter	211	71	23	0	292
System	903	650	166	5961	7666

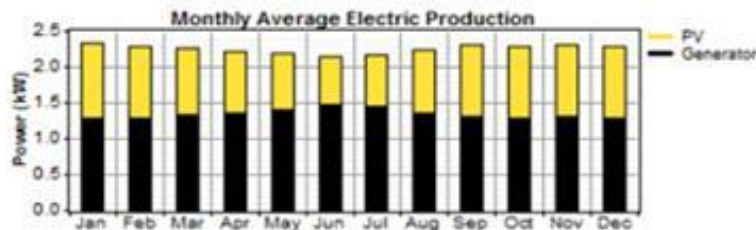


**Fig. 6.** Monthly average electric production

Table 5 shows PV only parameters and performance reflecting a capacity shortage as PV alone can only meet the load during the day. In Figure. 7, PV array monthly hourly performances are shown and the corresponding PV generation output in each month are as displayed. PV penetration is refers to the ratio of total peak PV power to peak load apparent power and the renewable fraction is the fraction of the energy delivered to the load that originated from renewable power sources.

**Table 5.** PV array performance

Quantity	Value	Quantity	Value
Rated capacity (kW)	5	Hours of operation(hr/yr)	4360
Mean output (kW)	0.905	Levelized cost (\$/kWh)	0.0835
Mean output (kWh/d)	21.7	Excess electricity (kWh/yr)	1025
Capacity factor (%)	18.1	Unmet load (kWh/yr)	335
Total production (kWh/yr)	7925	Capacity shortage (kWh/yr)	335
Min. output (kW)	0	Renewable fraction	0.342
Max. output (kW)	4.83	PV penetration (%)	43.4

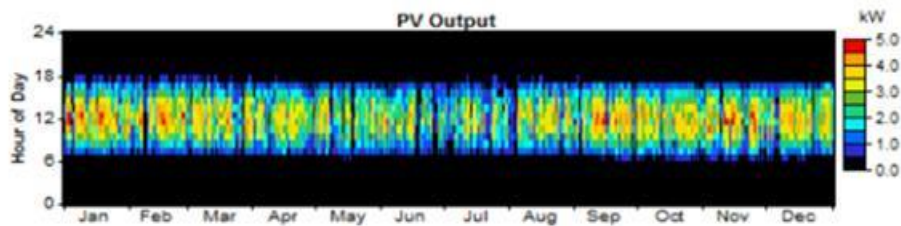


**Fig. 7.** PV array monthly performances

The diesel generator and battery parameters as well as the performance summaries are shown in Tables 6 and 7 and in Figure. 8. It is shown that the diesel generator operates mainly during night times and also during times when PV cannot meet the demand. It is important to take note of the expected battery life, which is very short though there are other battery technologies with longer life periods. The life span of the battery also depends on how the battery is used amongst other factors. Because of the short life span, the user(s) will have to replace this component of the hybrid system quite often during the life time of the system and this makes the system expensive.

**Table 6:** Diesel generator performance

Quantity	Value	Quantity	Value
Electrical energy production (kWh/yr)	11784	Fuel consumption (L/yr)	4967
Mean electrical output (kW)	1.65	Specific fuel consumption (L/kWh)	0.422
Min. electrical output (kW)	0.75	Fuel energy input(kWh/yr)	48880
Max. electrical output (kW)	2.5	Mean electrical efficiency (%)	24.1

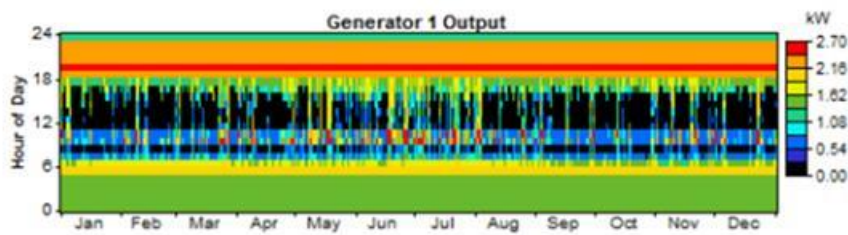

**Fig. 1.** Diesel hourly output

In Table 7, throughput refers to the change in energy level of the storage bank measured after charging losses and before discharging losses or simply the sum of the discharge energy. The battery wear cost on the other hand defined as the cost of cycling energy through the battery bank while the battery depletion is the difference between the state of charge of the battery at the beginning and at the end of the year.

**Table 1:** Battery parameters and performance

Quantity	Value	Quantity	Value
Nominal capacity (kWh)	2.4	Energy in(kWh/yr)	450
Usable capacity(kWh)	1.44	Energy out(kWh/yr)	361
Autonomy(hr)	0.691	Storage depletion(kWh/yr)	1.47
Lifetime throughput(kWh)	917	Annual throughput (kWh/yr)	404
Battery wear cost(\$/kWh)	0.488	Expected life(yr)	2.27

Figure. 9 shows that the breakeven grid extension distance is 7.15 kilometres. The breakeven grid extension distance is the distance from the grid which makes the net present cost of extending the grid equal to the net present cost of the stand-alone system. The net present cost or life-cycle cost of a system is the present value of all the costs of installing and operating that system over the project lifetime, minus the present value of all the revenues that it earns over the project lifetime [13]. Further away from the grid, the stand-alone system is optimal. Nearer to the grid, grid extension is optimal. This means that in terms of cost, it is only economical to connect the grid for distances less than 7.15km, and for any distance beyond the

7.15 km it does not make any economic sense. For the site considered the grid is very far away so prospects of being connected are next to none as it will be very expensive.

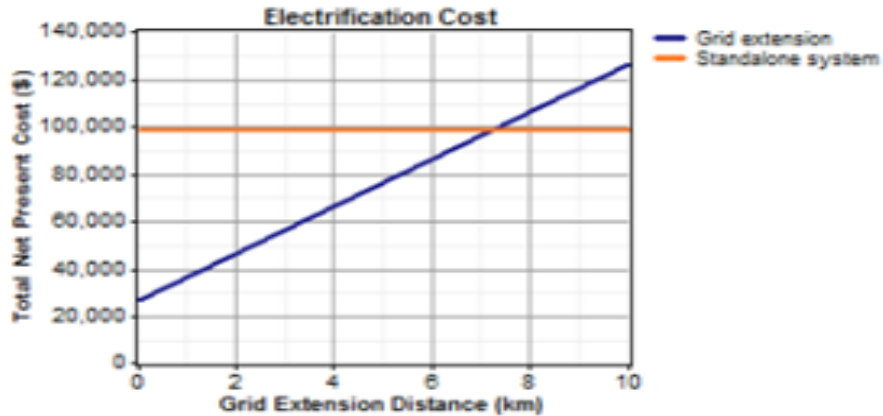


Fig. 2. Break even grid extension distance

## 5 Conclusion

It has been shown that solar PV alone even on a high power production day cannot meet the load as it is only available during the day. For the diesel generator to meet the load there are considerable costs involved in terms of fuel and maintenance costs. Combining PV and diesel generator systems results in fuel savings and reduced air pollution. It is observed that it is beneficial for the communities to use clean energy for especially for their day activities when sunshine is available. Such a hybrid energy system is shown to be a feasible solution for reducing energy poverty and the livelihoods of many rural communities. Use of fossil fuel based options and batteries in rural communities especially at household level remain a big challenge due the high operational and maintenance costs and replacement costs. Various implementation models have also been presented to assist decision makers.

**Acknowledgments.** The authors acknowledge the support for this work provided by the Council for Scientific and Industrial Research and the University of Johannesburg, South Africa.

## References

- [1] Carlson, G. and Clancy, J.: Gender and Energy for Sustainable Development: A Toolkit and Resource Guide (2004)
- [2] Lund, H.: Renewable energy strategies for sustainable development. *Energy*, 32(6), 912-919 (2007)
- [3] Urmee, T., Harries, D., Schlapfer, A.: Issues related to rural electrification using renewable energy in developing countries of Asia and Pacific. *Renewable Energy Journal*, 34, 354–357 (2009).
- [4] Hove, T. and Tazvinga, H.: A techno-economic model for optimising component sizing and energy dispatch strategy for PV-diesel-battery hybrid power systems. *Journal of Energy in Southern Africa*, 23(4), 18-28 (2012)
- [5] Tazvinga, H., Thopil, M., Numbi, P.B., Adefarati, T., 2017. Distributed Renewable Energy Technologies. In *Handbook of Distributed Generation* (pp. 3-67). Springer International Publishing
- [6] Wang, C. and Nehrir, M.H.: Power management of a stand-alone wind/photovoltaic/fuel cell energy system. *IEEE transactions on energy conversion*, 23(3), pp. 957-967 (2008)
- [7] Fulzele, J.B., Dutt, S.: Optimum Planning of Hybrid Renewable Energy System Using HOMER. *International Journal of Electrical and Computer Engineering*, 2, 68-74 (2012)
- [8] Ajao, K.R., Oladosu, O.A. and Popoola, O.T.: Using HOMER Power Optimization Software for Cost Benefit Analysis of Hybrid-Solar Power Generation Relative to Utility Cost in Nigeria. *International Journal of Research and Reviews in Applied Sciences*, 7(1), 96-102 (2011)
- [9] H. Tazvinga, B. Amigun, W. Stafford and M. Mapako, “Can solar-biogas hybrid systems be the solution to sustainable energy supply in rural areas?” 19th International Conference on the Domestic Use of Energy, Cape Peninsula University of Technology, Cape Town, Cape Town, 2011
- [10] IEA PVPS Task 9 Implementation Models for PV Part 1: Summary Report IEA PVPS T9-02: 2003 1 Summary of Models for the Implementation of Photovoltaic Solar Home Systems in Developing Countries
- [11] Rolland, S. and Glania, G., 2011. Hybrid mini-grids for rural electrification: lessons learned, Alliance for Rural Electrification.
- [12] <http://microgridnews.com/category/homer-energy/> (accessed 15/3/2017)
- [13] <http://www.homerenergy.com/support/docs/3.9/index.html> (accessed 20/3/2017)